




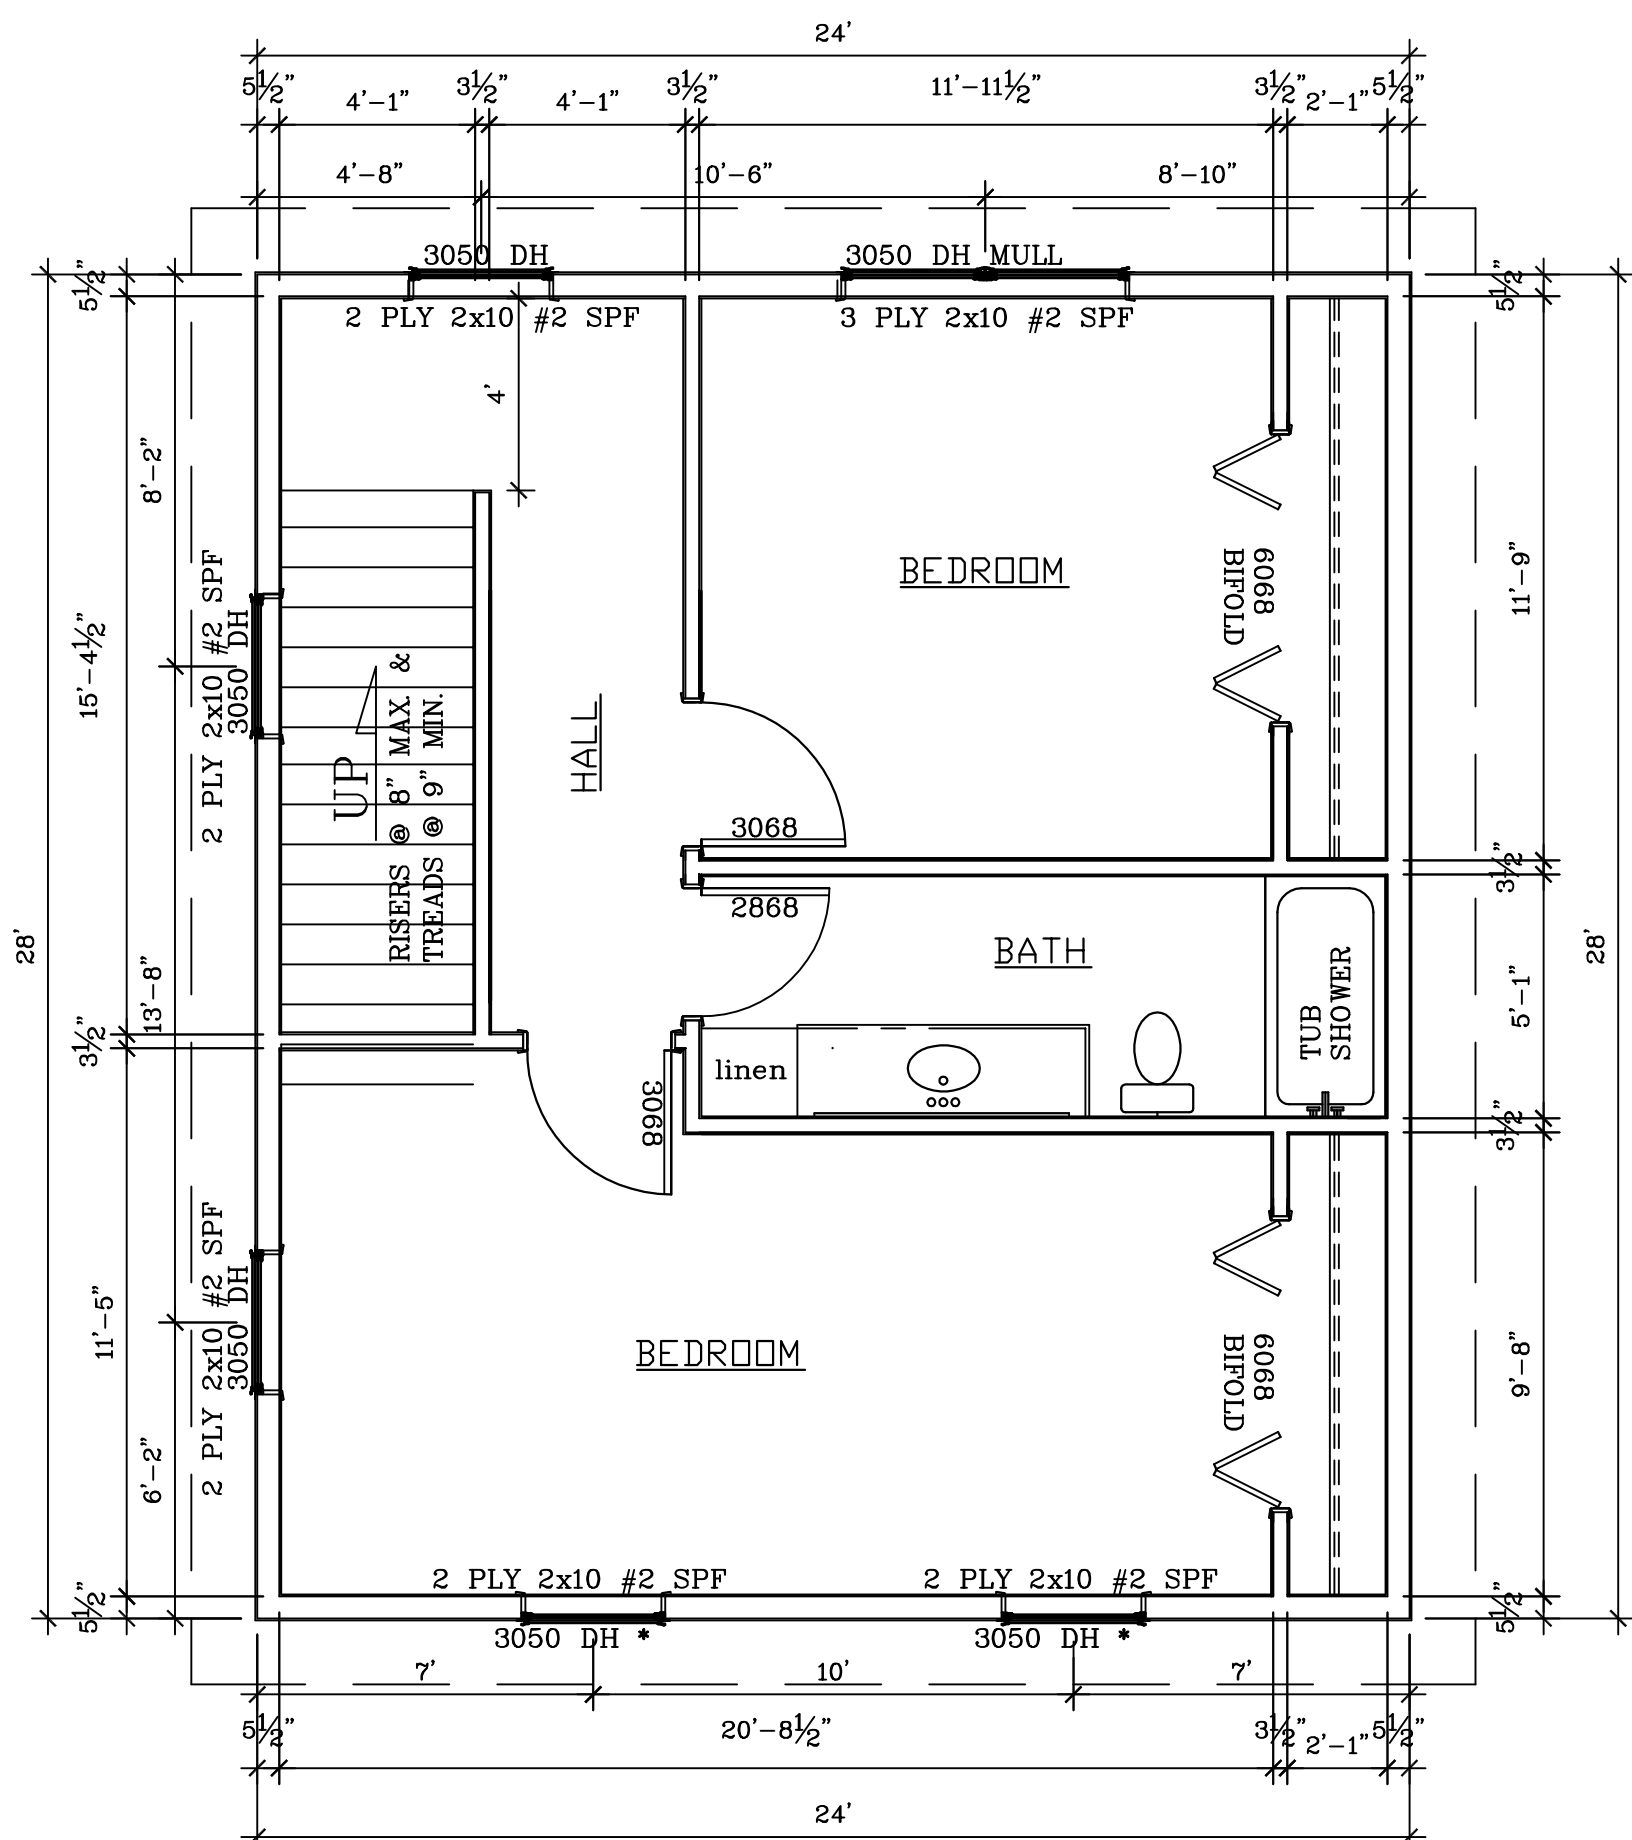


SECOND FLOOR PLAN
SCALE: 1/4" = 1'-0"

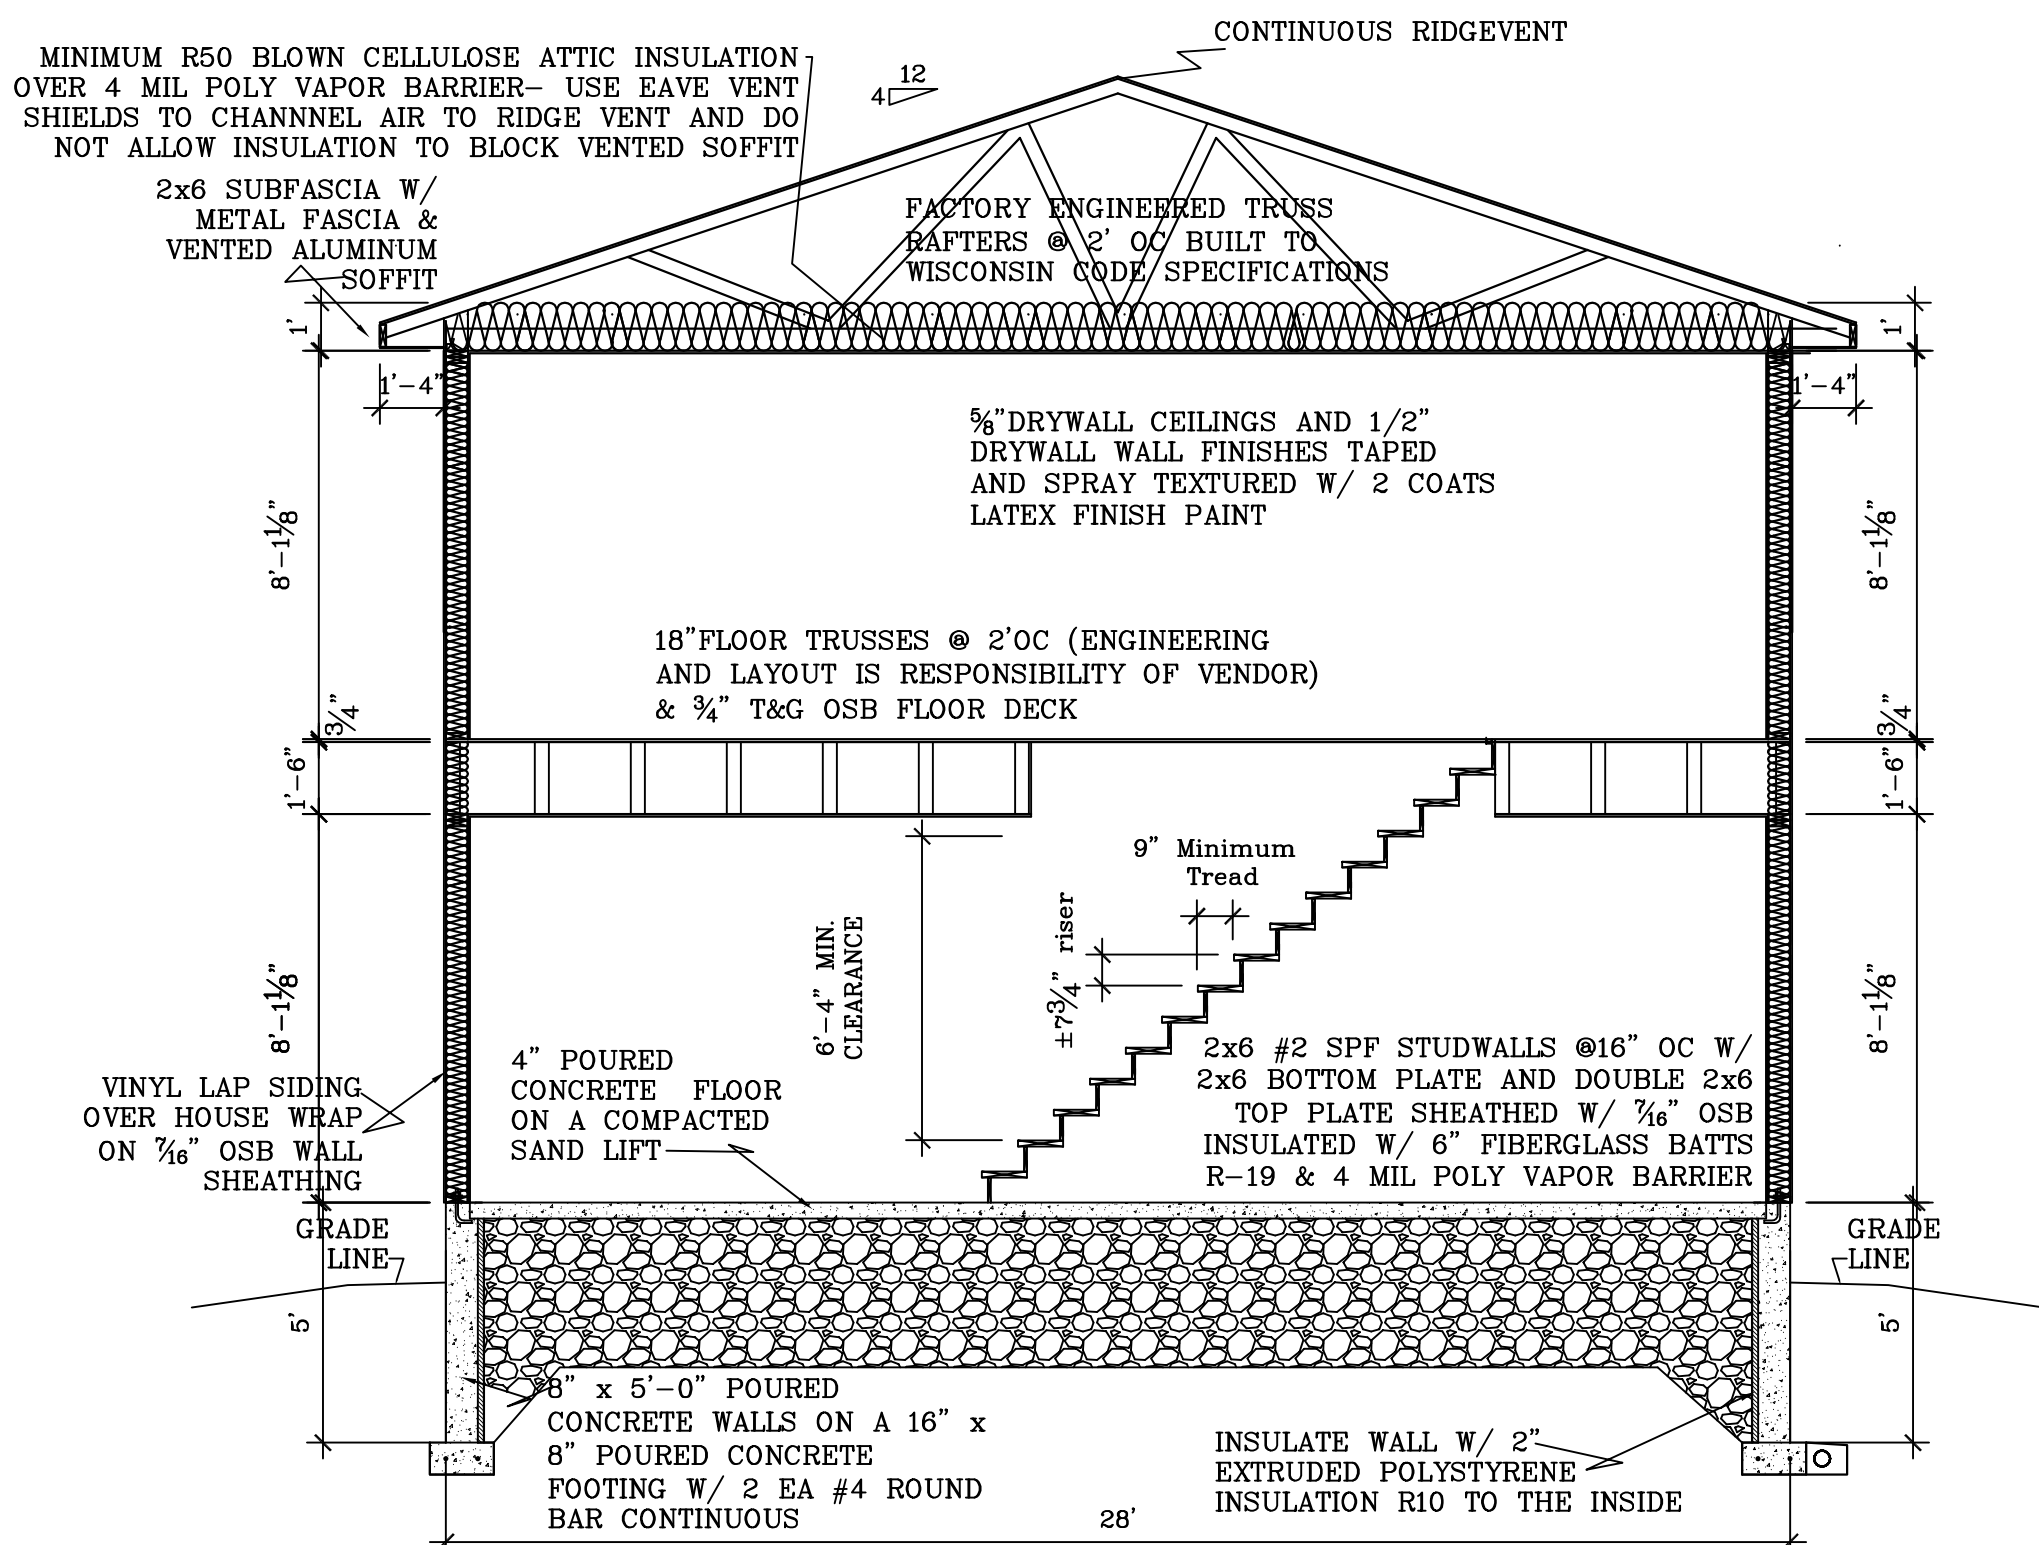

CROSS SECTION
SCALE: 1/4" = 1'-0"

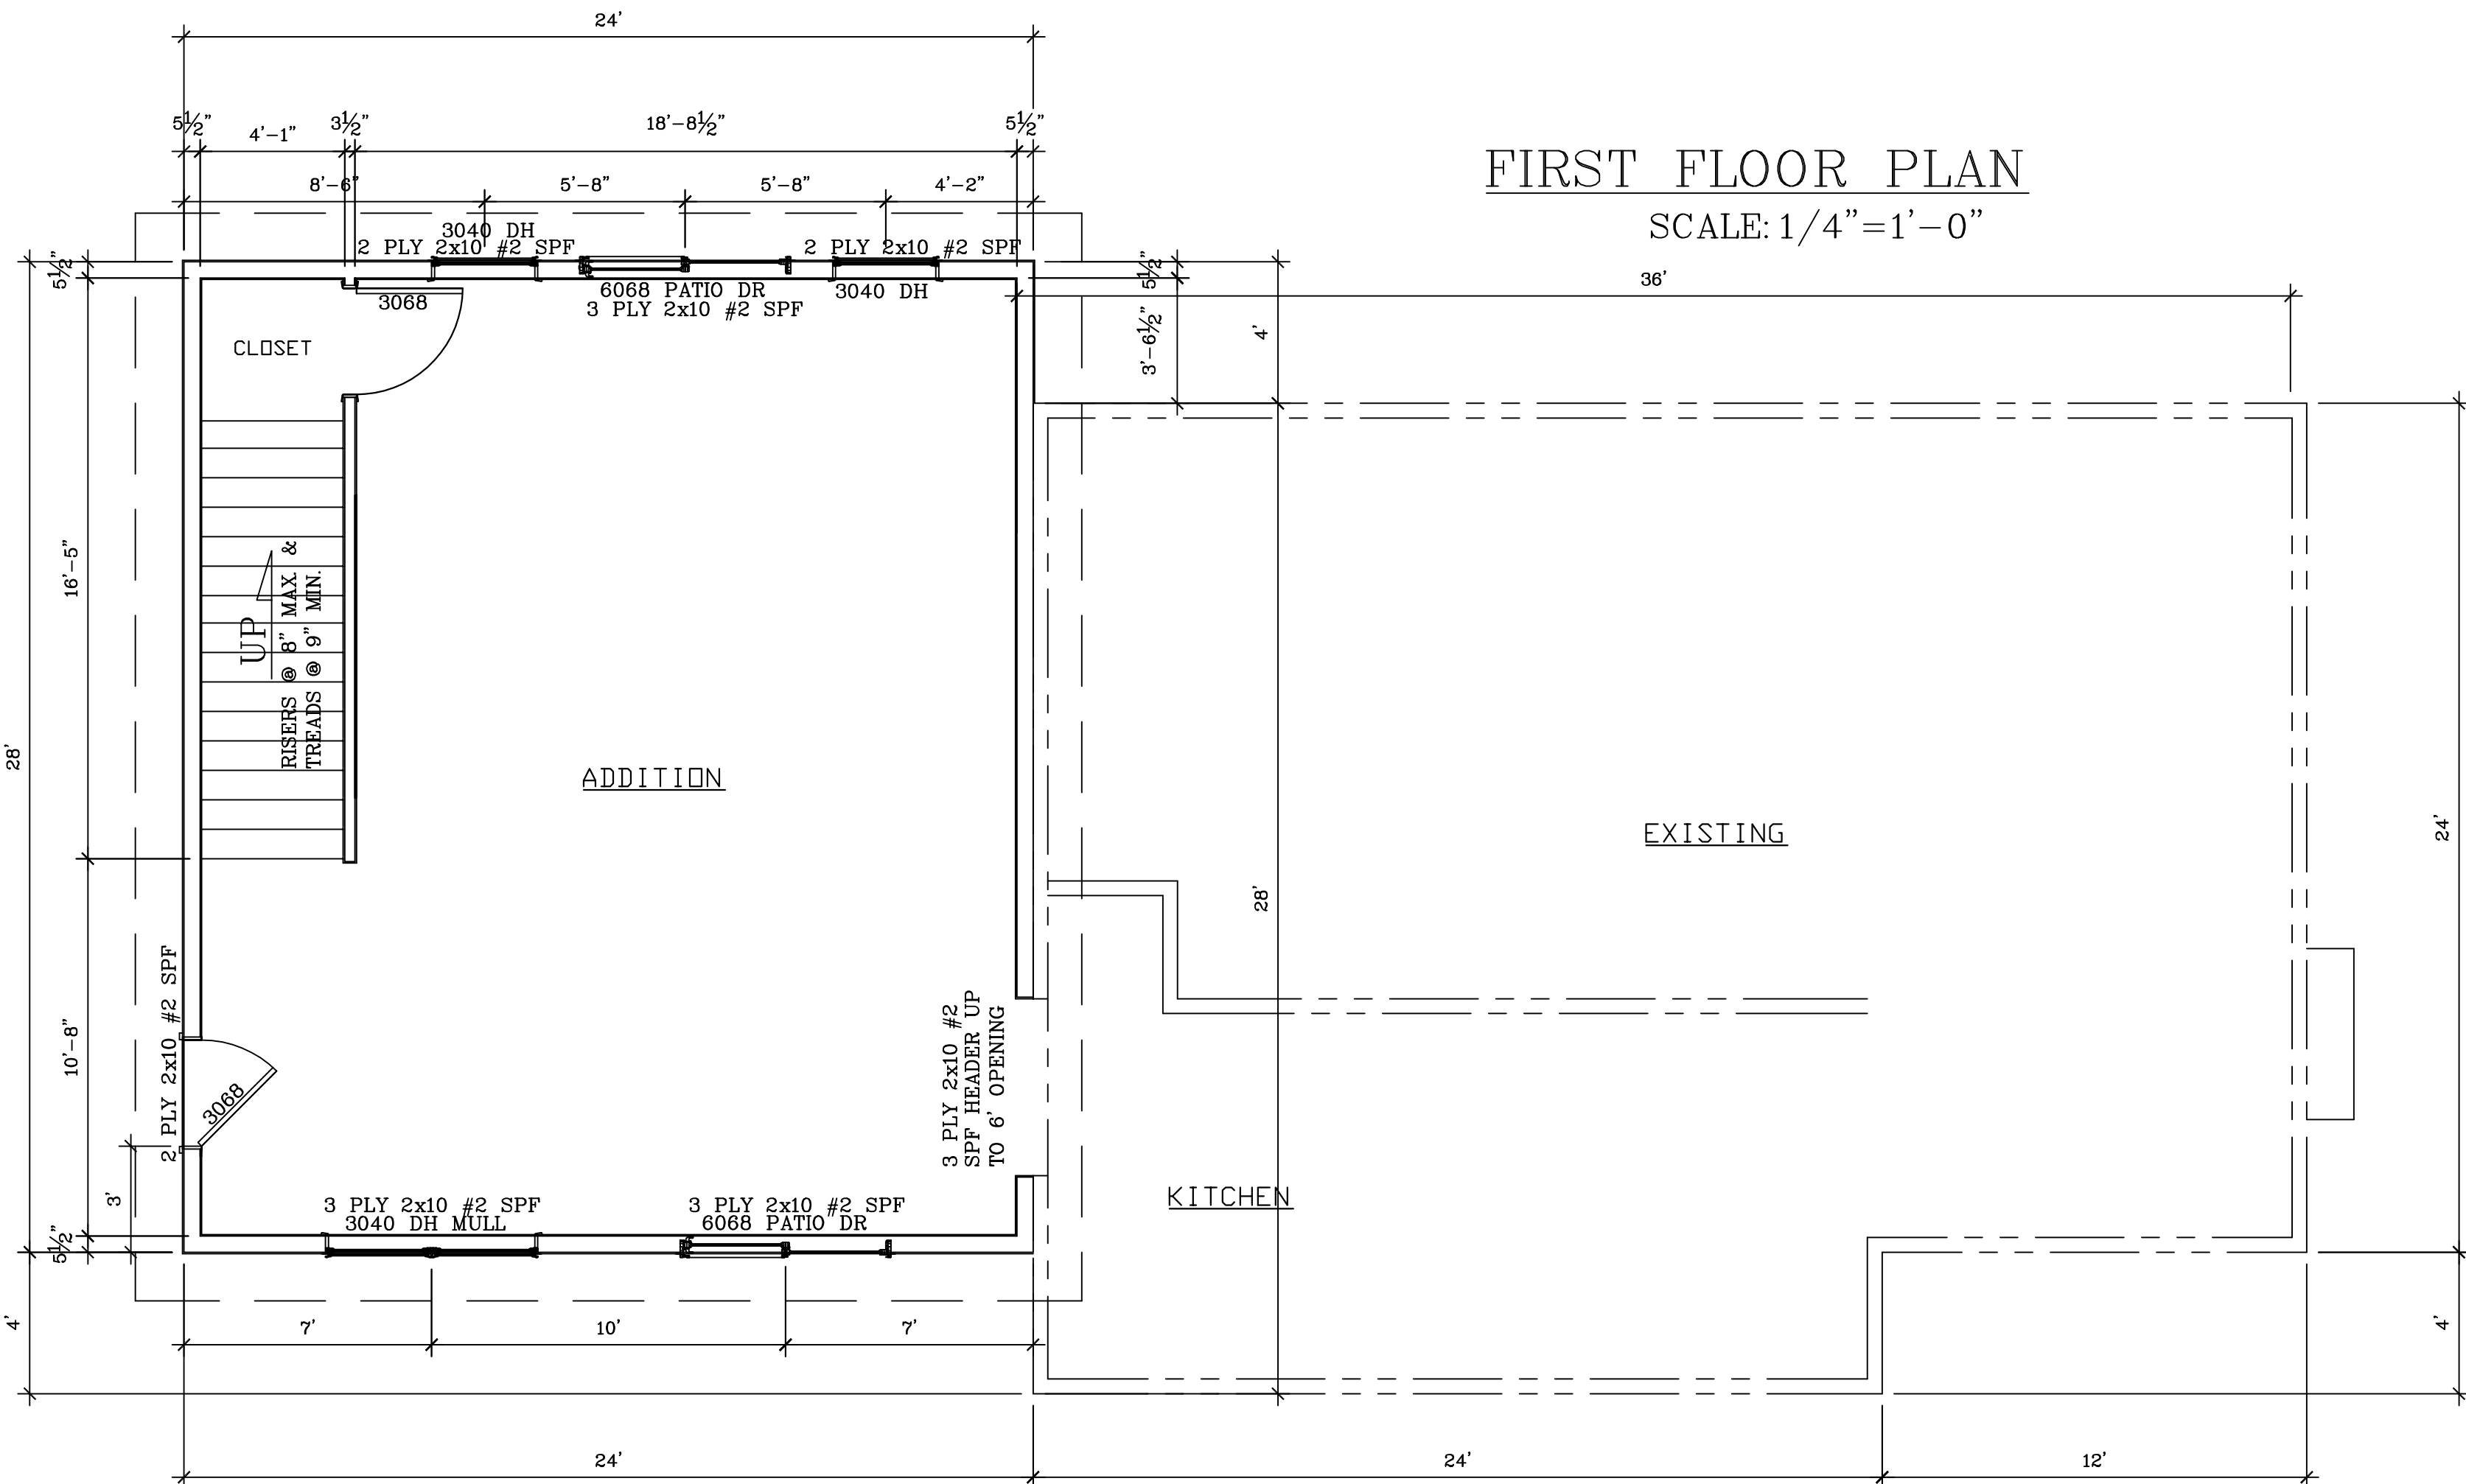

FIRST FLOOR PLAN
SCALE: 1/4" = 1'-0"

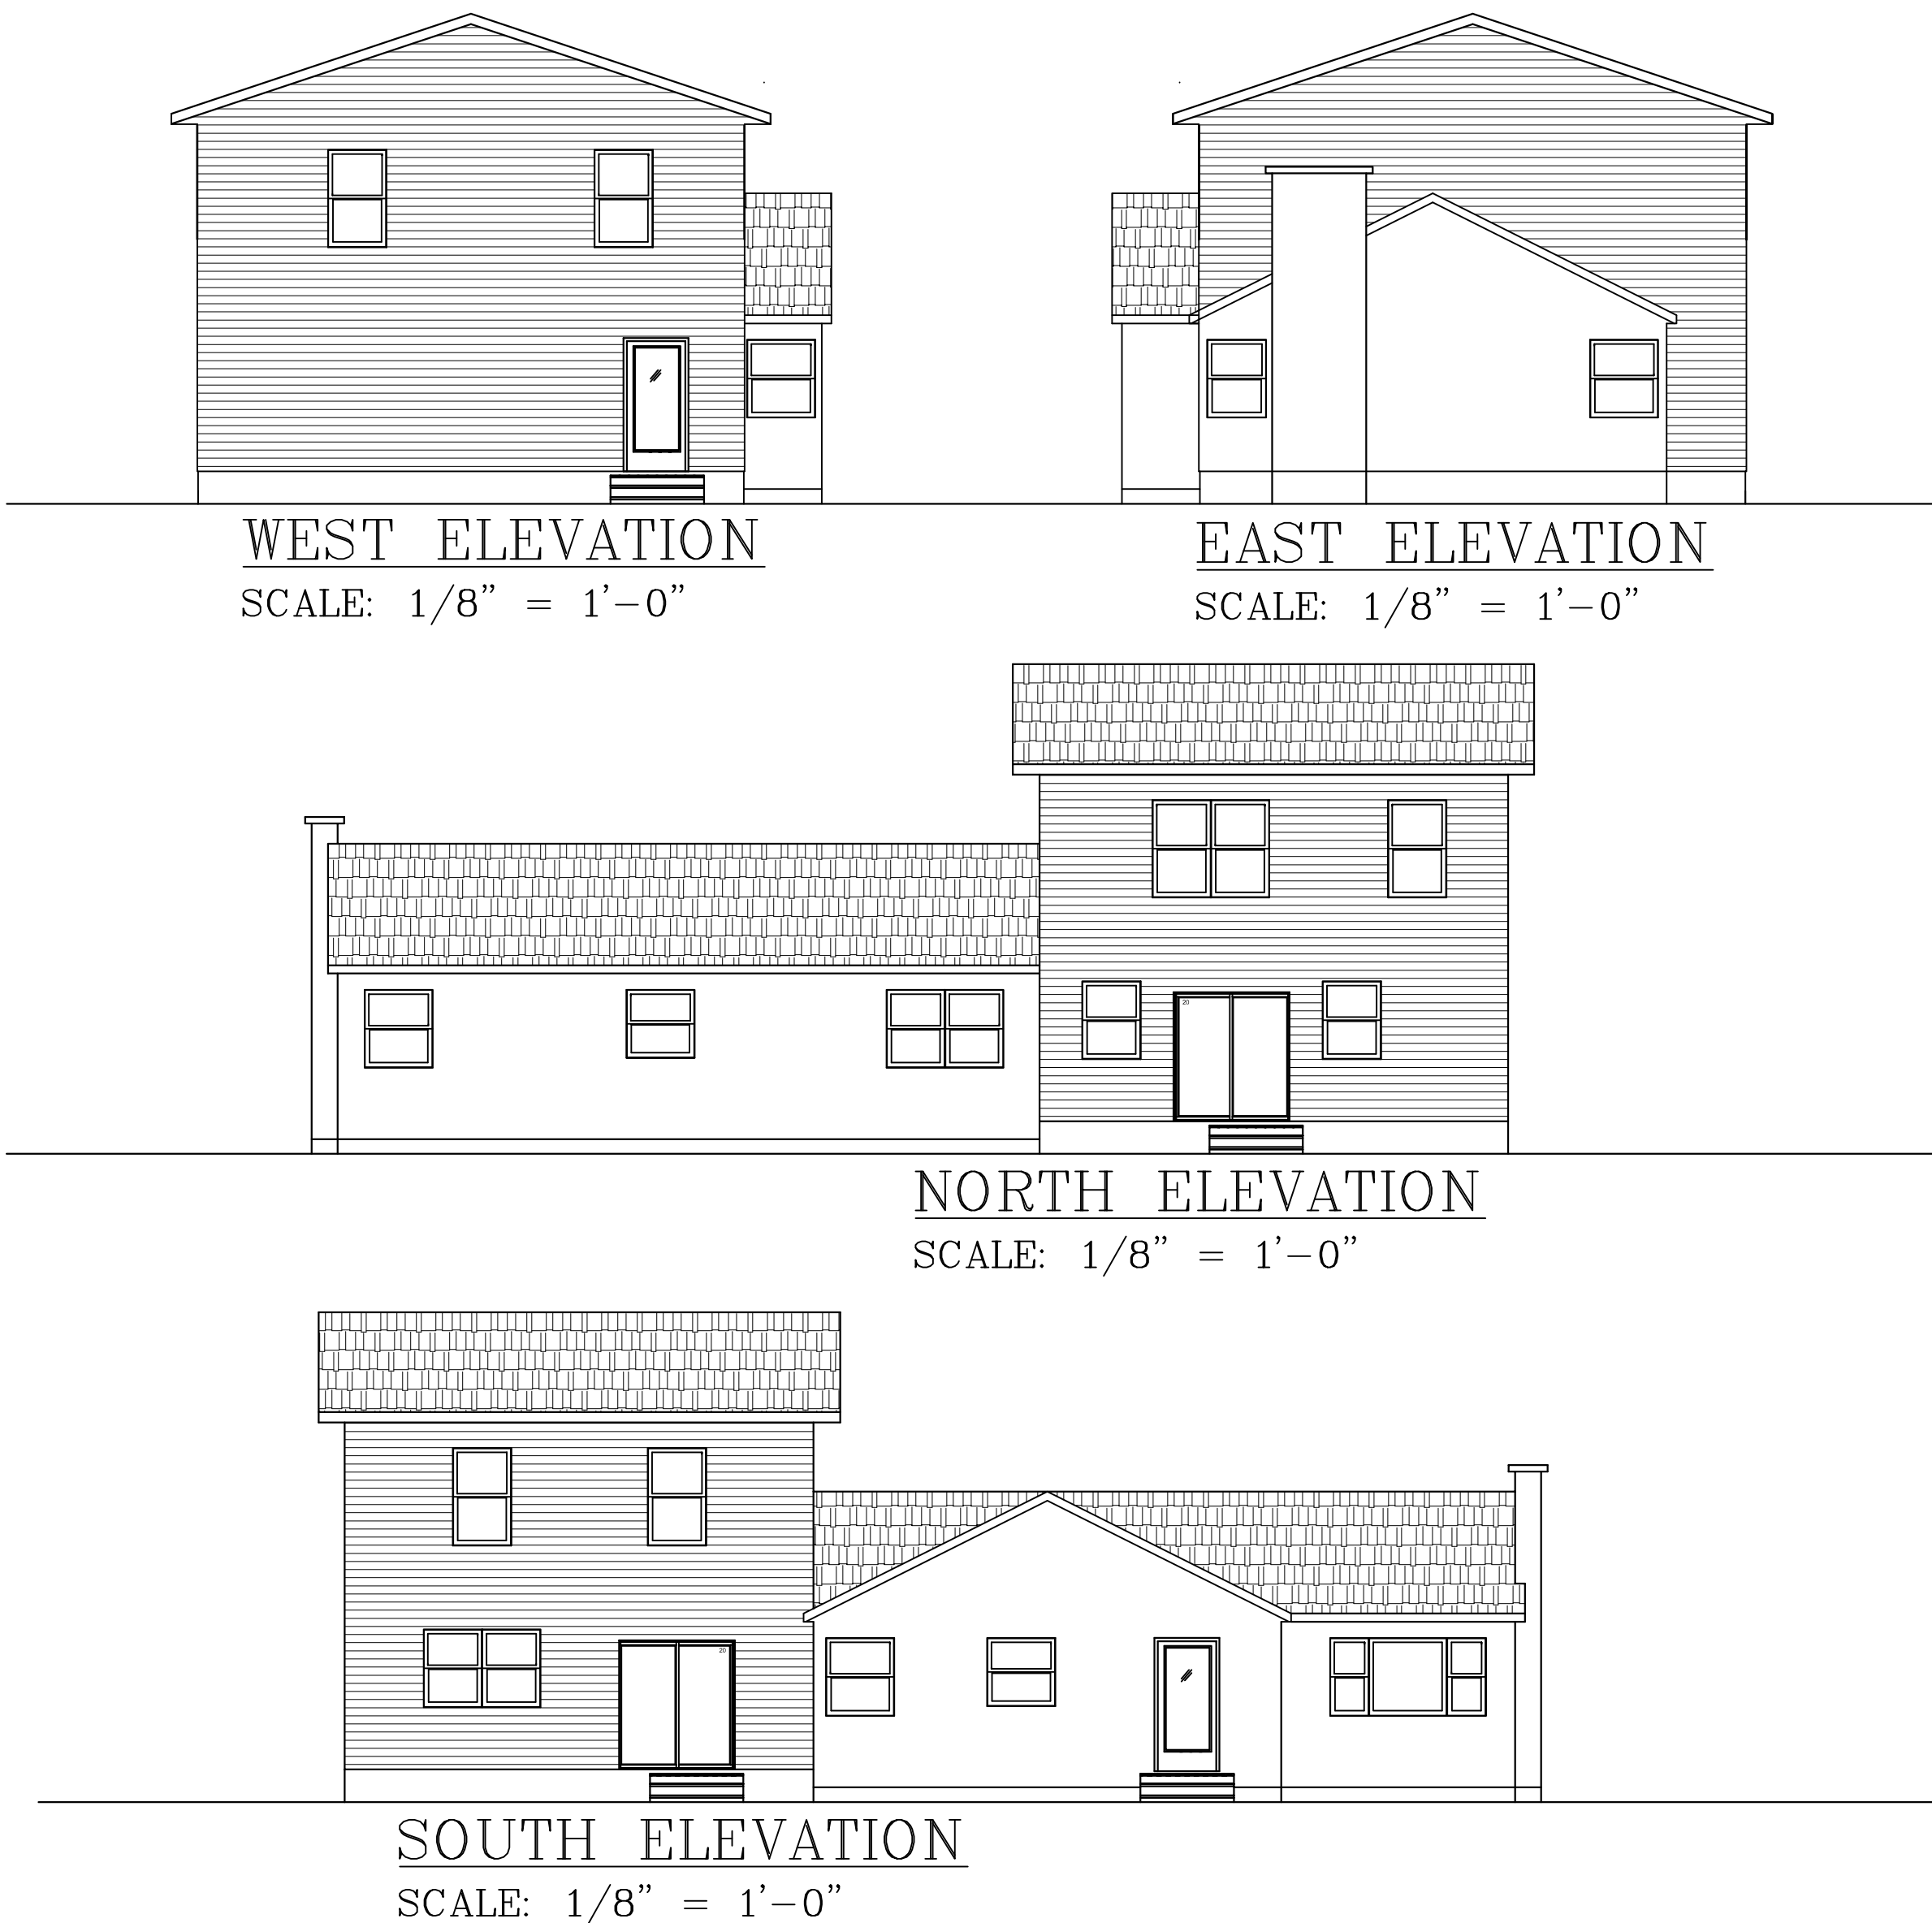

Wall Bracing Compliance Worksheet						
Complete this worksheet or provide equivalent information on the plans submitted with the permit application.						
Sketch and dimension the building plan and the wall bracing rectangle(s) per 321.25(8)(c)1. and Figure 321.25-B. Provide and label additional sketches if the building plan/rectangles change at different floor levels.						
Indicate applicable Wall Bracing Method for each level (see Table 321.25-G), each labeled rectangle if more than one (see 321.25(8)(c)), and amount of bracing (# of braced panels or length of braced wall required) per the respective table (provide additional worksheets for additional rectangles as needed).						
Rectangle:	Wall Ht. =	Eave to Ridge Ht. =	Max. Opening Ht. =	Wind Exp. =	Multipier for Height if not 10' =	Multipier for NO Interior GB =
A	8'-0"	5'-0"	8'-8"	B	0.9	1
	Walls		Continuous method (CSWSP, CS SFB) and total length required per Table 321.25-J		PF Method (see Figure 321.25-A). Indicate number of PF panels 16'-24' wide provided.	
	Supporting: roof & ceiling only		Min. panel width (Table 321.25-G) for WSP = 4'		Min. PF width (Fig. 321.25-A) = 18"	
	Min. panel width (Table 321.25-G) for GB = 8'		Min. panel width (Table 321.25-H) = 32"			
	Long side	Short side	Long side LF	Short side LF	Long side LF	Short side LF
Roof and ceiling only	2		8.5	8.5		
One floor, roof and ceiling						
Two floors, roof and ceiling						
Indicate location of required braced wall panels determined above on each rectangle side as required by Figure 321.25-C.						

Page 1 of 1


WALL BRACING RECTANGLE SKETCH

NOTE: See Wall Bracing Sketch above for Wood Structural Panel Wall Bracing Location- See Wall Bracing Compliance Worksheet to Left that Minimum Braced Panel Width = 32', Brace 8'-6" of Wall per Floor as Shown.

NOTE: WSP- Wood Structural Panel to be 3/8" for maximum 16"o.c. stud spacing; 7/16" for maximum 24"o.c. stud spacing.


Max. wall height to be 10'. Panel width to be 48". Fasten with 6d common nail or 8d box nail (2-1/2" long x .113" diameter) spaced 6" o.c. on the edges, and 12" o.c. in the field using nails or 7/16" crown 16 gage staples, 1-1/4" long spaced 3" o.c. on the edges, and 6" o.c. in the field using staples.

NOTE: A braced wall panel must start within 12'-6" from the end of a rectangle side & braced panels must be spaced a maximum of 21' edge to edge along the rectangle side.

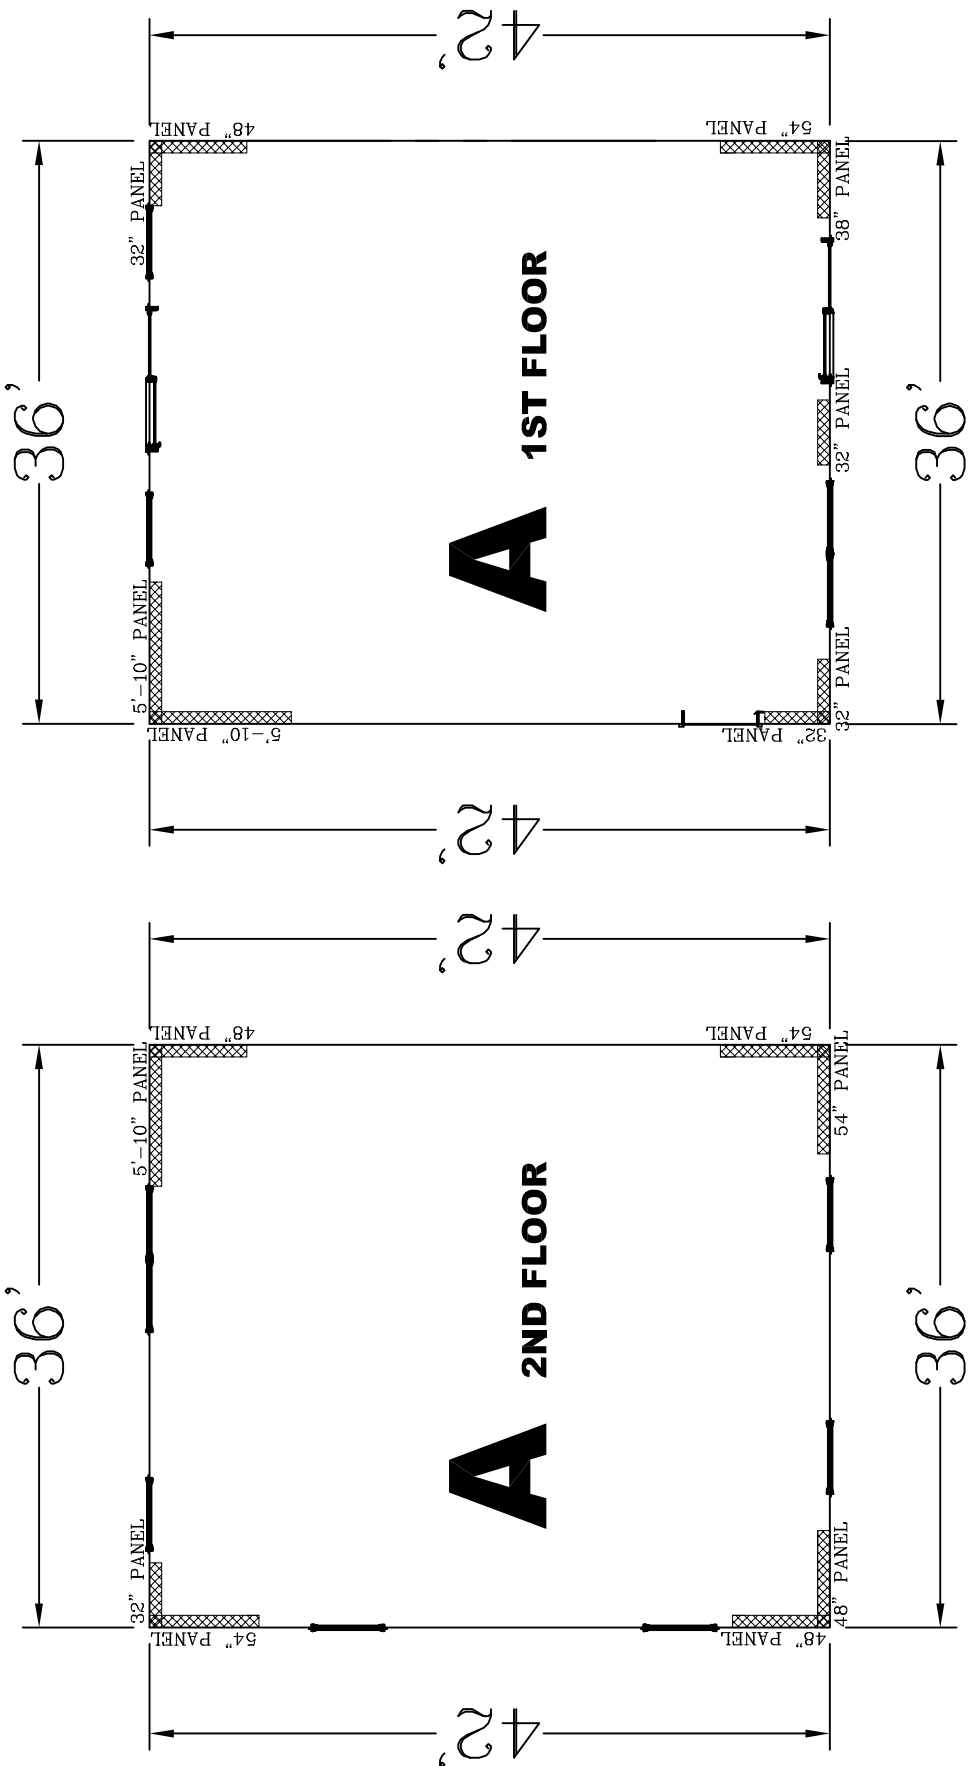

PROPOSED ADDITION FOR

BESTIMATE LLC

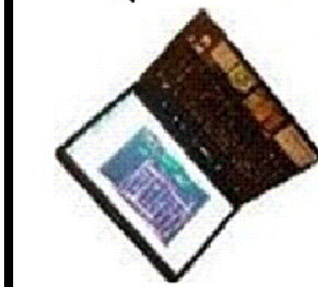

<http://bestimate.com>
714 E Ninth St
Marshfield, WI 54449